


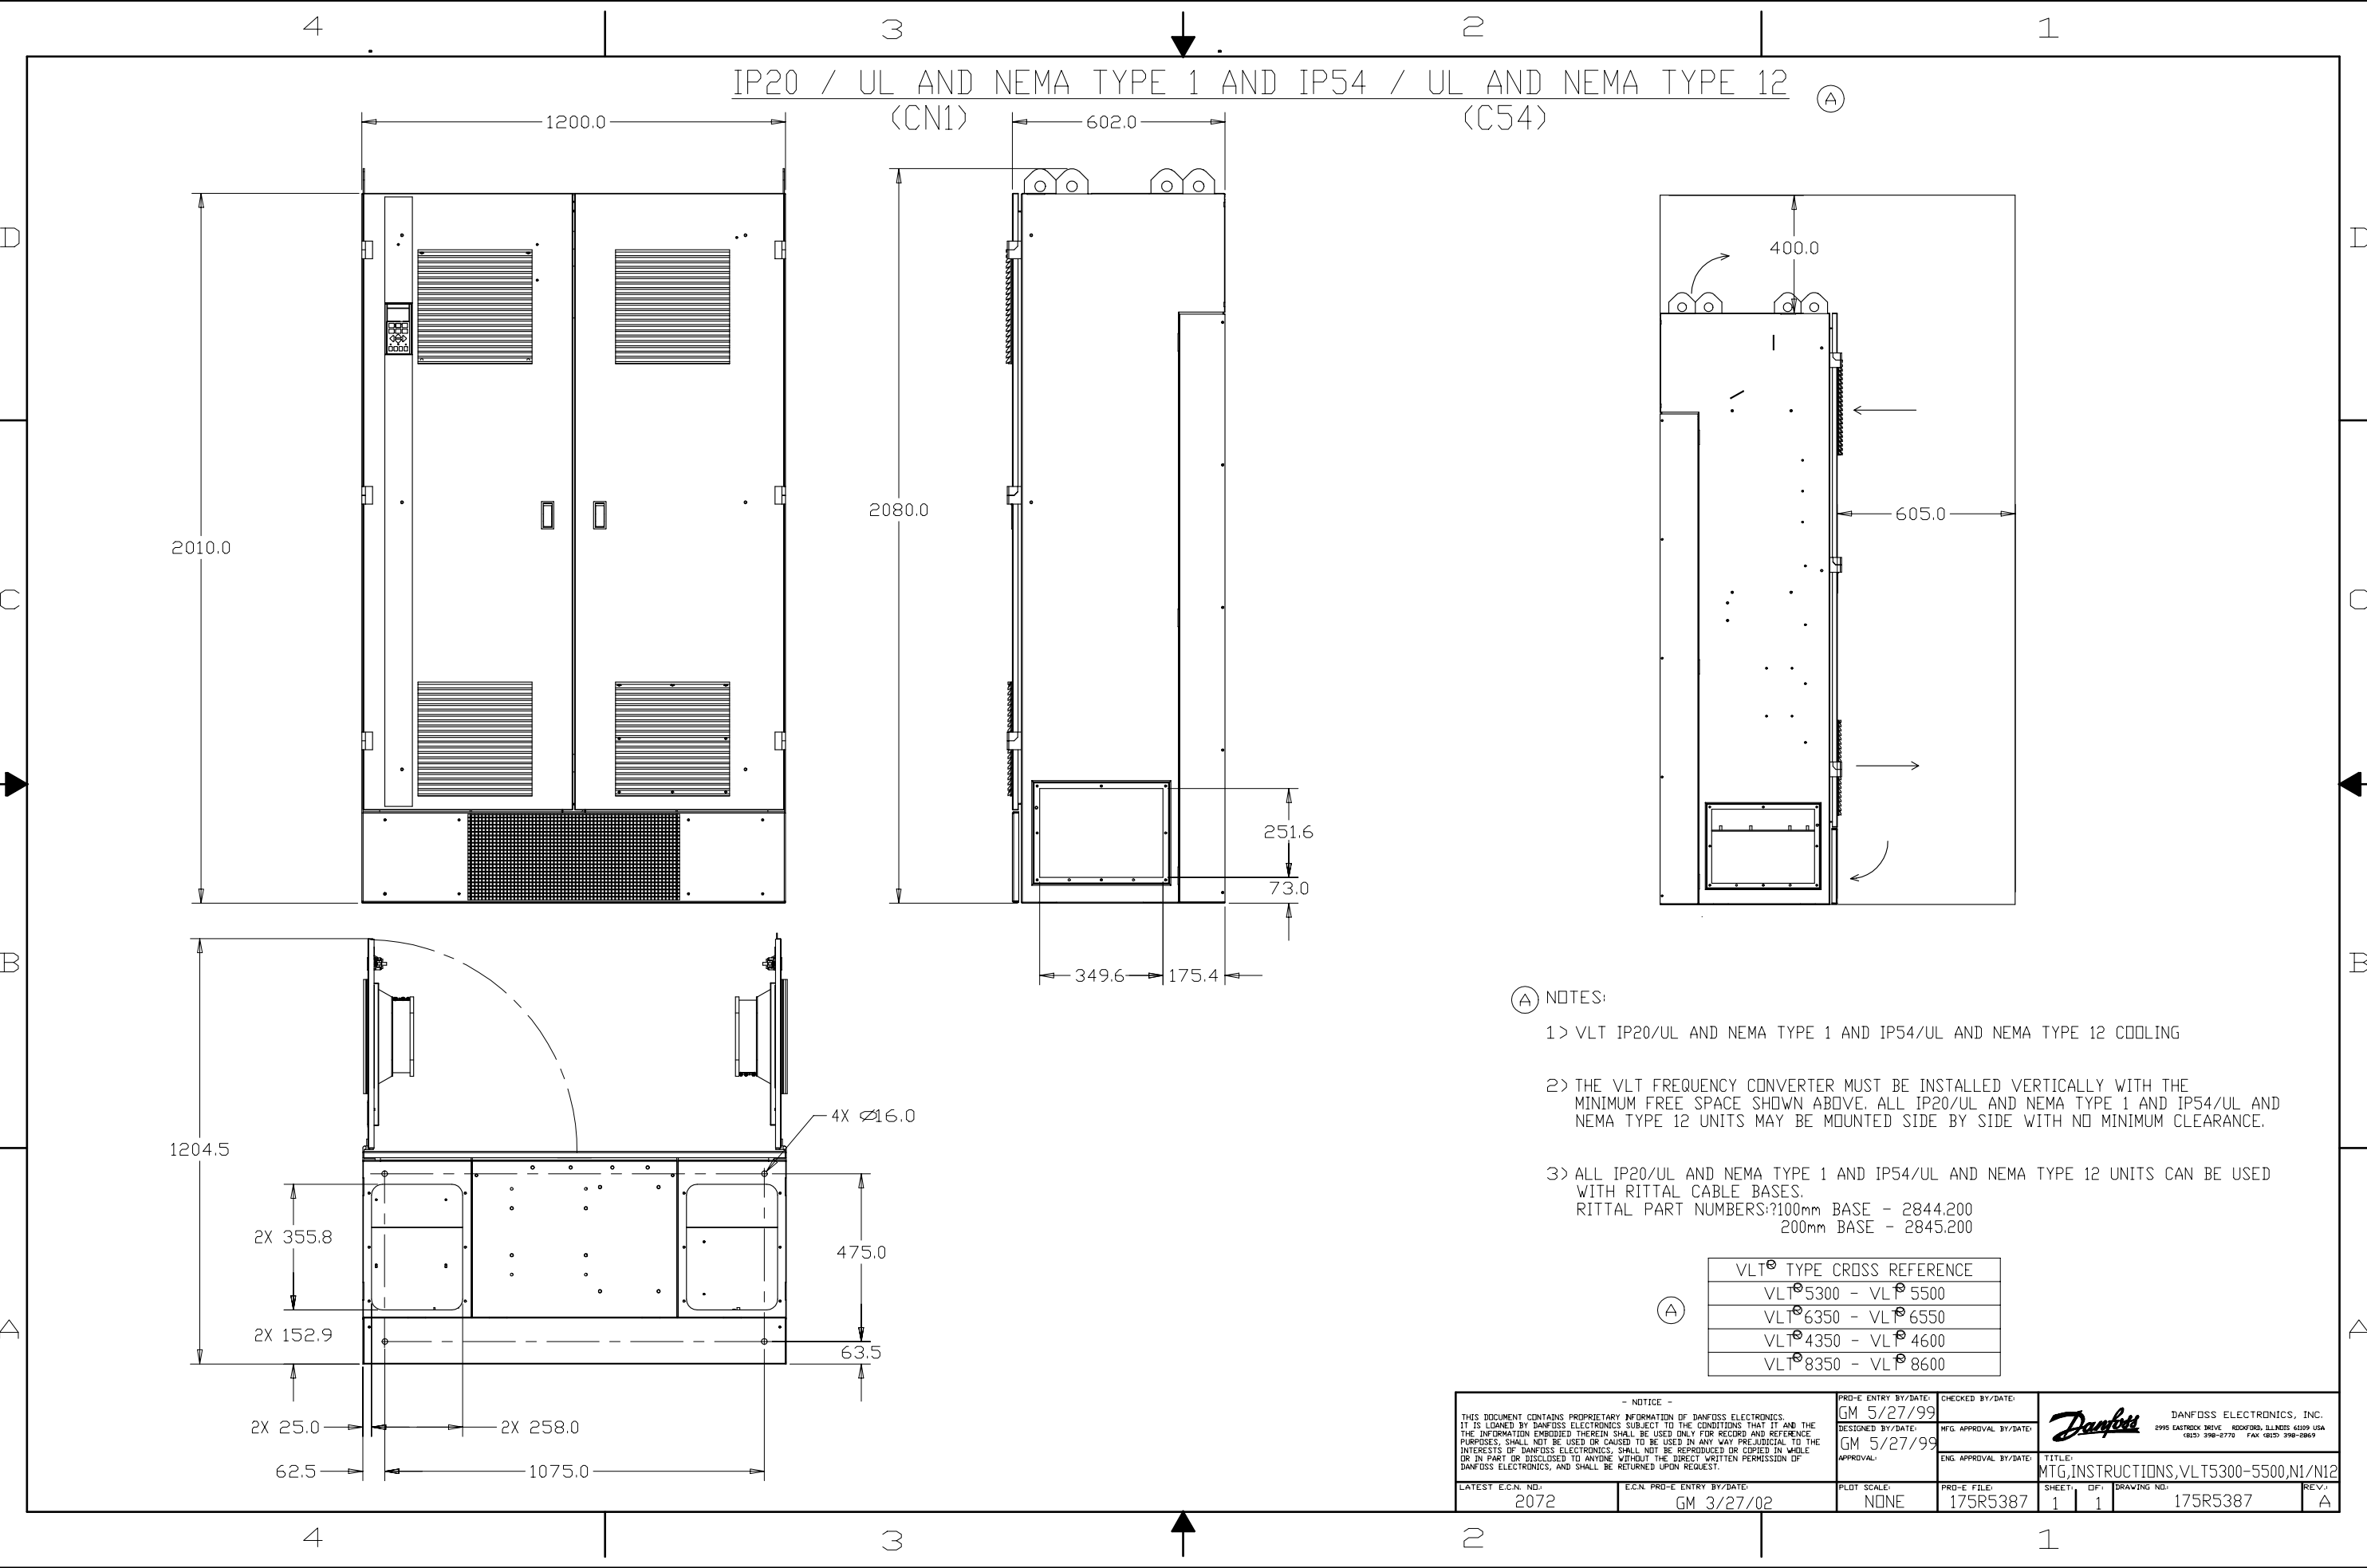

- NOTES:
- 1> VLT IP20/UL AND NEMA TYPE 1 AND IP54/UL AND NEMA TYPE 12 COOLING
 - 2> THE VLT FREQUENCY CONVERTER MUST BE INSTALLED VERTICALLY WITH THE MINIMUM FREE SPACE SHOWN ABOVE. ALL IP20/UL AND NEMA TYPE 1 AND IP54/UL AND NEMA TYPE 12 UNITS MAY BE MOUNTED SIDE BY SIDE WITH NO MINIMUM CLEARANCE.
 - 3> ALL IP20/UL AND NEMA TYPE 1 AND IP54/UL AND NEMA TYPE 12 UNITS CAN BE USED WITH RITTAL CABLE BASES.
RITTAL PART NUMBERS: 100mm BASE - 2844.200
200mm BASE - 2845.200

VLT TYPE CROSS REFERENCE

VLT 5300 - VLT 5500
VLT 6350 - VLT 6550
VLT 4350 - VLT 4600
VLT 8350 - VLT 8600

- NOTICE - THIS DOCUMENT CONTAINS PROPRIETARY INFORMATION OF DANFOSS ELECTRONICS. IT IS LOANED BY DANFOSS ELECTRONICS SUBJECT TO THE CONDITIONS THAT IT AND THE INFORMATION EMBODIED THEREIN SHALL BE USED ONLY FOR RECORD AND REFERENCE PURPOSES. SHALL NOT BE USED OR CAUSED TO BE USED IN ANY WAY PREJUDICIAL TO THE INTERESTS OF DANFOSS ELECTRONICS. SHALL NOT BE REPRODUCED OR COPIED IN WHOLE OR IN PART OR DISCLOSED TO ANYONE WITHOUT THE DIRECT WRITTEN PERMISSION OF DANFOSS ELECTRONICS, AND SHALL BE RETURNED UPON REQUEST.		PRO-E ENTRY BY/DATE: GM 5/27/99	CHECKED BY/DATE:	 DANFOSS ELECTRONICS, INC. 2995 EASTROCK DRIVE ROCKFORD, ILLINOIS 61109 USA (815) 398-2770 FAX (815) 398-2869
		DESIGNED BY/DATE: GM 5/27/99	MFG. APPROVAL BY/DATE:	
		APPROVAL:	ENG. APPROVAL BY/DATE:	TITLE: MTG, INSTRUCTIONS, VLT 5300-5500, N1/N12
LATEST E.C.N. NO: 2072	E.C.N. PRO-E ENTRY BY/DATE: GM 3/27/02	PLOT SCALE: NONE	PRO-E FILE: 175R5387	SHEET: 1 OF 1 DRAWING NO.: 175R5387 REV.: A